

WVC-1400 micro inverter WiFi/433MHz Version User manual



http://www.kaidengdg.com

DongGuan KaiDeng Energy Technology Co., Ltd.

东莞市凯登能源科技有限公司 Address: 4F, FuYuan Business Center, MaiYuan Rd., Xin'An Community, Chang'An Town, DongGuan City, GuangDong Provicen, China.

> Post:523850 Tel:+86-769-81888842 Fax:+86-769-81888841 E-Mail:info@kaidengdg.com Contact:Mr.Carl Deng The contents listed in this manual are owned by Kaideng energy



WVC1400-433/WiFi **Micro inverter**



model	WVC1400-R3-433/W	iFi					
Maximum input power	1600Watt						
Output voltage mode	120/230V Auto switch						
PV Open circuit voltage	30-60VOC						
Operating voltage range	22-60V						
Starting voltage range	22-60V						
short-circuit current	65A						
Maximum working current	56A	56A					
Output parameters	@120V	@230V					
Output peak power	1600Watt	1600Watt					
Rated output power	1400Watt	1400Watt					
Output current	11.6A	6A					
AC voltage range	80-160VAC	180-280VAC					
AC frequency range	48-51Hz/58-61Hz	48-51Hz/58-61Hz					
Power factor	>95%	>95%					
Number of branch connections.	3PCS (Single)	6PCS (Single)					
Output efficiency	@120V	@230V					
Static MPPT efficiency	99.5%	99.5%					
Max output efficiency	95%	95%					
Loss of power at night	<0.5W	<0.5W					
Total current harmonics	<5%	<5%					
Appearance and tech	nical features						
Temperature range	-40°C to +65°C						
Size (L×W×H)	370mm×300mm×41.6mm						
Net amount	3.0kg						
Waterproof grade	Ip65 NEMA3R						
Heat dissipation mode	Self-cooling						
Communication mode	433MHz/WiFi						
Power transmission mode	Reverse transmission, Load	d priority					
monitoring system	Mobile phone APP、Brows	. ,					
electromagnetic compatibility	EN50081.part1 EN50082.Part1.CSA STD.C22.2 No.107.						
Power grid	EN61000-3-2 EN62109.UL STD.1741						
Power grid detection	DIN VDE 0126 IEEE STD. 1547, 1547, 1 and 1547.A						
certificate	CEC, CE, INMETOR, ETL, Patented technology						
Packing weight							
Specifications	Each (Packing)	Box (4PCS)					
weight	4.0KG 16.5KG						
Size	430×375×140mm 430×405×380mm						

Features

- Maximum power point tracking Adaptive voltage/frequency
- Reverse power transmission
- I / O, fully isolated
- Multiple parallel stacks


Parameter

Internal high precision meter
 Forward full-bridge topology

• 5G lot Platform management


• Voltage mode microgrid

- App monitoring system
- No installation, no maintenance

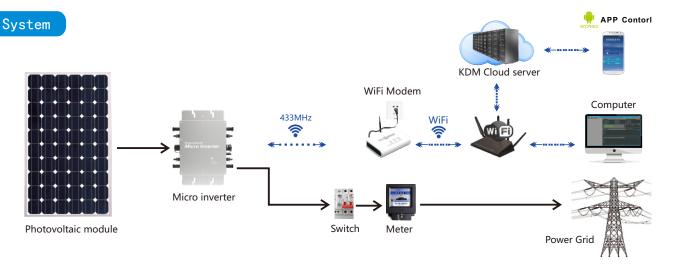




Appearance description of micro inverter

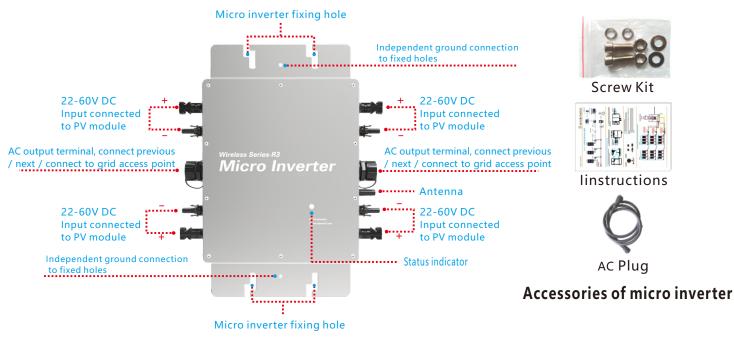

Description of the connector and cable core of the micro inverter

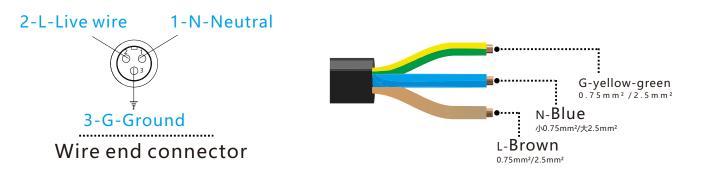

LED indicator function of micro inverter

1.Red light is on---The micro-inverter is powered on, the red light is on, and the equipment is ready to work;

2.Red light flashes----The micro-inverter is fully prepared and enters the delayed startup state;

3. Flashing green-----MPPTMaximum power point search status;

4.Green light is on----MPPTMaximum power point locked state;

5. The green light turns red----a. Island protection; b. Frequency protection; c. AC over/under-voltage protection; d. DC voltage over and under voltage protection; e. fault; f. software shutdown;

Normal working indicator flashing process:

Connect the micro-inverter to the AC and DC terminals, and then turn on the power \rightarrow the red light will be on for 3 seconds \rightarrow the red light will flash for 30 seconds \rightarrow the green light will flash quickly (MPPT maxim um power point search) \rightarrow The green light is on, (MPPT lock).



433MHz Long distance communication

The communication method of 433MHz is a short connection method, that is, the signal is disconne -cted after sending / receiving. The device for data collection with the inverter is WiFi-MODEM. The communication channel is civilian channel. Long-distance wireless transmission (open area up to 1800 meters, good wall penetration capability, air baud rate 500bps) Operating frequency range (433.4-473.0MHz, up to 100 communication channels) Maximum 100mW (20dBm) transmit power 8 levels of power can be set) Four working modes, suitable for different applications, please refer to the WiFi-MODEM instruction manual for specific usage details.




Power monitoring system diagram



WiFiData collector usage settings

1、Preparation for use:

If you want to use the monitoring system of WVC series micro-inverters, you must install and set up WVC series WiFi data collector. WiFi data collector is the data exchange bridge of WVC series micro-inverters. It is in the micro-inverter and mobile APP, The function of data collection and data exchange between computers, using 433MHz signal to send the voltage, current, temperature, power and other data of the micro-inverter to the KDM server via WiFi signal, mobile APP / computer can smoothly monitor the power generation data of the power station , Ple -ase connect the antenna and power cable of the data collector as shown on the right.

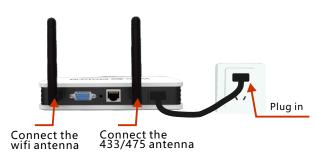


WiFi Modem hardware connection diagram




2、APP Phone Settings :

A) Please visit our company's official website to download the kaideng-app.apk app and install it on your Android phone, then click the Kaideng app to enter the login interface, then click the collector to initialize.As shown in Figure 1:

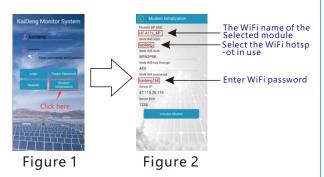


B) As shown in Figure 2, click the red circle to select HF-A11x_AP in the AP SSID of the collector, click the company WiFi SSID to select the WiFi network name in your home, and enter the password in the WiFi password.

C) After all are entered, first select the drop-down menu of the mobile phone and long press the network to select the HF-A11x_AP connection, as shown in Figure 3, and close the data connection of the mobile phone, as shown in Figure 4:



D) After all are entered, first select the drop-down menu of the mobilephone and long press the network to select the HF-A11x_AP connection, as shown in Figure 3, and close the data connection of the mobile phone, as shown in Figure 4:



E) Most smartphones automatically select a network. When the connected network pops up and there is no Internet access signal, be sure to choose to keep connected to ensure that the initialization is carried out smoothly, as shown in Figure 5, and the initialization is completed at the last point, as shown in Figure 6 As shown.

Note: Because HF-A11x_AP is not connected to the Internet, the Android phone will automatically disconnect the network, which will make our initialization unsuccessful. Please find the automatic switching functionin the Android phone's system settings and turn it off.

3、Computer Settings :

A) Click on the computer to connect to the WiFi network of HF-A11x_AP as shown in Figure 8, open the browser in the computer, enter the IP address: 10.10.100.254, enter in the name: admin, enter in the password field: admin.

As Shown in Figure 9:

Ċ

	服务器 10.10.100.254 将要求你输入用户名和密码。服务器报 告它来自 A11。				
其他人可能会看到你通过此网络发送的信息	警告: 将在不安全的连接上使用基本身份验证发送你的用户名 和密码。				
连接	admin 1				
備 kaideng 3	2				
	□ 记住我的凭握				
Figure8	3				
5	确定取消				

Figure9

- 1、Select STA mode on Mode Selection, as shown in Figure 10:
- $2\$ Click Search on the STA Interface Setting to search the network as shown in Figure 11:

Mode Selection 1	Working Mode Configuration	Mode Selection	STA Interface Settin	ng
AP Interface Setting STA Interface Setting Application Setting Device Management	Too may configure the Uart WIT models with mode and data to APP Model States Models Data Transform Model Data Transform Model Transmartent Mode V	STA Interface Setting Application Setting Device Management	You could configere STA interface STA interface Parameters AP's SSID MAC Address (Optional) Security Mode Encryption Type	BF-Allx_BF 2 Search IFF-Allx_BF 2 Search IFFE > Iffe
Fi	3 Aptr Carel		3 WAN Connection Typ	

Figure 10 Figure 11 3. Select your own network in the searched network list as shown in Figure 12:


4. Click Search on the STA Interface Setting to search the network, and enter the password in the Pass Phrase and click Apply, as shown in Figure 13:

٠	kaideeg 1	24.68.33.99.02.24			AE8	WPA2PSK	inh astructure						
0	ChinaNel-uQ/KA	\$4.66.6c.72.17.fb	15%	3	TKIP	WPA2P5K	infrastructure						
	ChinaNet-4206	48:s7:3c:3b:99:15	20%	4	TKIP	WPA2P5K	Infrastructure	Mode Selection		STA Interface	Settir	ng	
D	ChinaNel-16	e0.10.30-25.e4/3	20%	5	AE5	WPA2P5K	Infrastructure						
Ô.	5588	c0.3a:35.09.4t.41			AES	WPA2PSK	infrastructure	AP Interface Setting					
0	H162636	74:c1:41:29:44:34	10%	4	AES	WPA2PSK	infrastructure			You could configure STA in	terface p	arameters here.	
0	ChinaNel-AmSH	că 50 mil ne 01 54			TKIP	WPA2P5K	infrastructure	STA Interface Setting	1		_		
0		et 3c 10:64:32.75			AE8	WPA2PSK	Inhastructure		· ·	STA Interface Parameters			
2		2e3025ado:532e			TKIP	WPA2PSK	indo a structure	Application Setting			2		
0	ZRYIQI	10.60 de añ e7:84		<u> </u>	AE8	WPA2PSK	infrastructure			AP's SSID	2	kaideng	Search
2	TP-UNK_E058	de fe 10:54 e0 50			AES .	WPA2PSK	infrastructure	Device Management		MAC Address (Optional)			
0		oö 3e 35 eb 7d a1			AE5	WPA2P5K	inh astructure						
		e4 13 15 8x 55 32			AES	WPA2PSK	Infrastructure			Security Mode		WPA2PSK 🗸	
	403A	40 xee 5c da ac c2		13	AES	WPA2PSK	infrastructure			Encryption Type		AES V	
	ChiraNel-G/C/F	10:52:02:54:11:26			AES	WPA2PSK	Infrastructure				_		
	11.2	bc 54 %; d2 ec 50	prs.	10	AES	WPA2PSK	Infrastructure			Pass Phrase		kaideng168	
14	ply Marsh												_
											- 4	Apply Cancel	
Figure12							WAN Connection Type:			DHCP(Auto config) 🔹			
			<i>,</i>	•		_			DHCP Mode				

Figure13

5、In Application Setting, select Mode as Client> enter Port 1234> enter Server Address 47.115.28.119> click Apply to confirm as shown in Figure 14:

6、Restart the device in Device Management to complete the settings as shown in Figure 15:

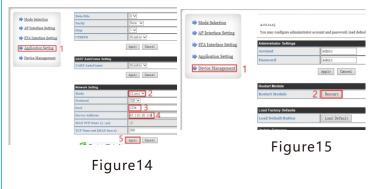

WVC Series micro inverter

Click here to complete



4. Use of APP :

Please visit our company's offici -al website to download the kai -deng-app.apk app and install it on your Android phone, then cli -ck the Kaideng app to enter the login interface, click to register a new account, then click to log in to the power station interface and click Add Power Station As shown on the right.

KaiDeng Mo	nitor System	C Ka	iDeng Monitor S	System 💮
1 kaideng		<u>.</u> G	邓均平光伏电站 高州市长流祥地村73号	2018-02-06 [1] [6]
A		<u>i</u> G	割型能源 言源商务中心	2019-09-04 [2] [14]
Save 1	username and passwor	10	宿舍 长安这边	2019-09-15 [0] [4]
Login	Forgot Password	10	20041510 Ggh	2020-04-15 [0] [1]
Register	Modem Initialization			
1		A		
Allasheren		Ya		
		ł	Click her	e.
		-	Add Station	

power station, select "No" in the opt

-ox, fill in the number in the bar code

Address information Please enter each item related to the

"No" must be entered here i-on of whether there is an electric b

Found behind the collector in the option of

"1" must be entered here the collector, enter "1" in the calcula

Fill in the actual installed -tion ratio, the other according to the actual Just enter.




Add the inverter to the inverter addition page, enter the inverter code in the Inve -rter Code field, and then click Single Add to complete the addition of the inverter, as shown on the left.

The pictures on the right are "In -verter Data Detail Page" and "I -nverter List Page". To view the data details of a single inverter, click the icon in the inverter list to open the inverter data Details.

16:08 54 54 1	1.91	•	16:08 54 54 11	21	@ = 0
\bigcirc			\bigcirc		
Vi Wi DC Si CC Vi Vi Wi Posser To Start	meri(App) 134 App(VhC) 28 enti(Vanc) 29.6 enti(Vanc) 27.1 map(VhC) 43.4 enti(Vanc) 43.4 enti(V		200424FF 1 Inverters	Inverte	r.
Batch Start			Batch Startup	Batch Shutdown	Batch Online Tes

4. Immediately monitor your power plant and keep track of your power plant data :

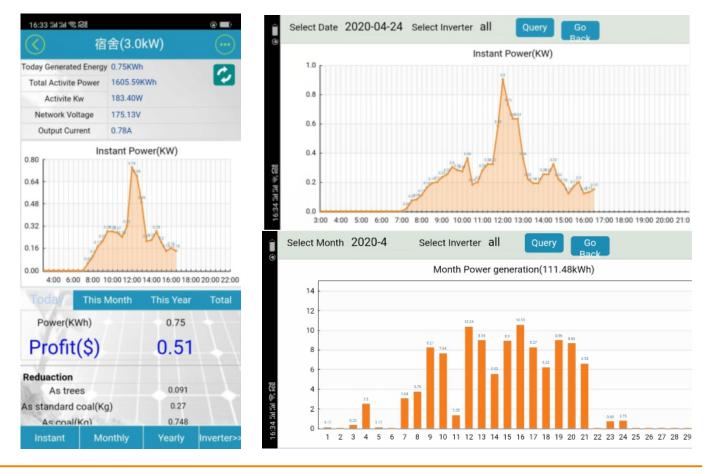



Kaideng WVC series micro-inverter installation guide

To properly install and use Kayden Energy WVC series micro inverters, please read and follow this guide and all warnings and ins -tructions in Kay Energy WVC micro inverters. The "Installation and Operation Manual" can be downloaded from the official w -ebsite of Kaden Energy: www.kaidengdg.com.Safety warnings are listed on the back of this guide. All models of WVC Series Mic -ro inverter listed in this guide have a ground wire in the AC cable, no additional ground electrode is required(EGC), there are thr -ee wires in-side the AC cable with equipment, which are Blown zero line N (Blue) ground wire / safety line G (Yellow & green). Ea -ch micro-inverter is equipped with an AC cable with a length of 3 * 4 * 2 meters. The current of each AC cable branch cannot be greater than 40A. For the number of connected branches of each branch, refer to the following installat-ion guide. **Important information:** Kaideng Energy WVC series micro-inverters use IP65 waterproof rating. When installing, please try to install it in a place where there is no rain, nor in a place where the sun is exposed to ensure ventilation and heat dissipation.

Preparation before installation:

 Please visit our company's official website www.kaidengdg.com to download the kai -deng-app.apk app to install on your And -roid phone, then open the app and regis -ter an account on it, and create a power station on the account to reverse the WVC series. The inverter is monitored or contro -lled. For detailed operation, please refer to the instructions in the inverter monitor -ing section.



- 2、The device for data collection with the inverter communication is WiFi-MODEM, and the communication method between WiFi -MODEM and inverter is long-distance wireless transmission (o -pen field 1800 meters, air baud rate 00bps). Operating frequen -cy range (433.4-473.0MHz Up to 100 communication channels) Maximum 100mW (20dBm) transmit power (8 levels of power can be set) Four working modes, suitable for different applications, please refer to the WiFi-MODEM manual for details.
- 3、Please refer to the following list and compare the electrical par -ameters of the solar modules in the table to select the inverter model.

Inverter model	Connector	Photovoltaic module
WVC-295	1*MC4	
WVC-300	1*MC4	
WVC-350	1*MC4	The number of mat
WVC-600	2*MC4	-ched photovoltaic modules is 60 strin
WVC-700	2*MC4	-gs / 72 strings / 90
WVC-1000	2*MC4	strings. The open c -ircuit voltage Voc
WVC-1200	4*MC4	is between 30-60V
WVC-1400	4*MC4	
WVC-1600	4*MC4	
WVC-2000	4*MC4	


- 4. In addition to Kaideng Energy's WVC series micro-invert -ers, you must also purchase photovoltaic brackets / AC boxes / electrical cables and other related materials. The current of each channel of the WVC series micro-inverte -rs at the branch of the installed circuit cannot exceed 40 Amp, if the rated current is exceeded, it may lead to an un -safe factor.
- 5. Check if you still have the following related equipment: AC junction box, tools: screwdriver, wire cutter, voltmeter, tor -que wrench, socket and wrench for installing hardware, etc.

- 6. After the installation of the power station is completed, ple -ase install a ground wire on the photovoltaic support, inst -all and use a lightning protection and / or surge suppress -ion equipment protection system in the AC junction box. It is very important to have a switch device that automatically protects against lightning strikes and surges.
- 7. When installing the inverter handshake cable, please plan th -at your AC branch circuit cannot exceed the current limit, so that the maximum number of micro-inverters in each branch can be reasonably allocated.

Inverter model	Number of branches
WVC-295	30PCS
WVC-300	30PCS
WVC-350	25PCS
WVC-600	15PCS
WVC-700	12PCS
WVC-1000	10PCS
WVC-1200	8PCS
WVC-1400	6PCS
WVC-1600	5PCS
WVC-2000	5PCS


*Each region may be different. Please refer to local requirem -ents to define the number of micro-inverters per branch in your area.

- 8 Implement all national electrical codes (NEC), ANSI / NFPA 70 in accordance with all local electrical codes and all relev -ant regulations.
- 9、Please note that only qualified personnel can install and / or replace Kaideng micro-inverters.
- 10, Please do not try to repair Kaideng micro-inverter. It does n -ot contain user-serviceable parts. If it fails, please contact Kaideng customer service to obtain the ID number and start the replacement process. Tampering or opening the Kaideng micro inverter will invalidate the warranty.
- 11, Before installing or using Kaideng Micro Inverter, please rea -d all instructions and technical instructions and the warning mark system and photovoltaic array on Kay Microinverter.
- 12, Please make sure that the installation operation is performed before the AC power is disconnected, and do not install the K -aideng micro-inverter with power on.
- 13. Please install Kayden micro inverter series products as shown in the following figure.

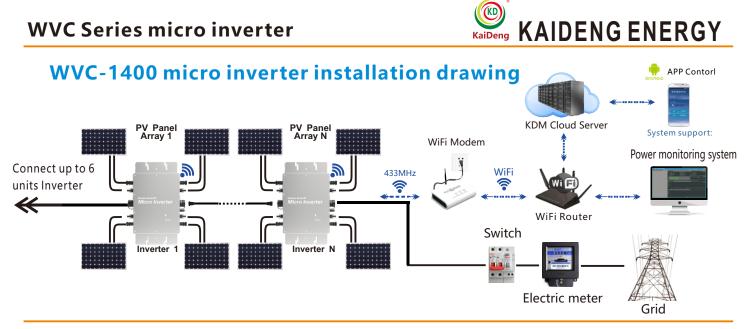


Inverter installation steps


Step1 Install the inverter on the bracket of the photovoltaic panel with the screws pro vided with the machine, as shown in the fo -llowing figure:




-Itaic board to the DC input terminal of the inv -erter, as shown below:

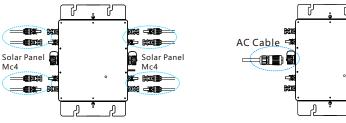

Step2 Connect the positive and negative poles Step3 Open the waterproof cover of the AC output of the DC connection MC4 plug on the photovo connector of the inverter and connect the AC cable to the AC waterproof plug. The connection method is as shown in the plug connection diagram:






Step 4 Connect the AC output cable to the AC main cable;

Step 5 Repeat steps 1 to 3, install and connect all inverters;

Step 6 Connect the AC main cable to the utility grid to start your green energy journey.

Note: Before installing WVC series micro inverter products, please read this manual and pay attention to the installation details.

This manual contains important instructions that should be followed when installing and maintainingReduce the risk of electric shock and ensure safe installation and ope -ration of Kaideng MicroInverters, Always follow the following safety symbols present in this document to indicate hazardous conditions and important safety Instructions.

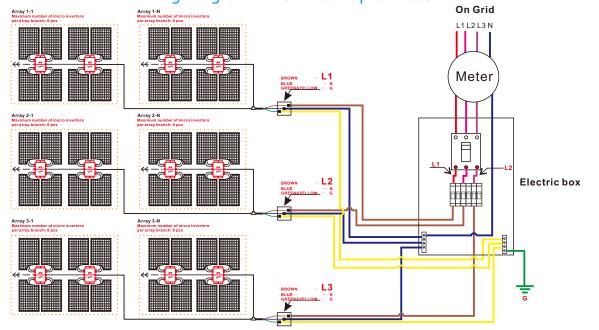

Wiring Diagram WVC-1400 Triple Phase